


2000 GALLON TANK
 $1/2" = 1'-0"$

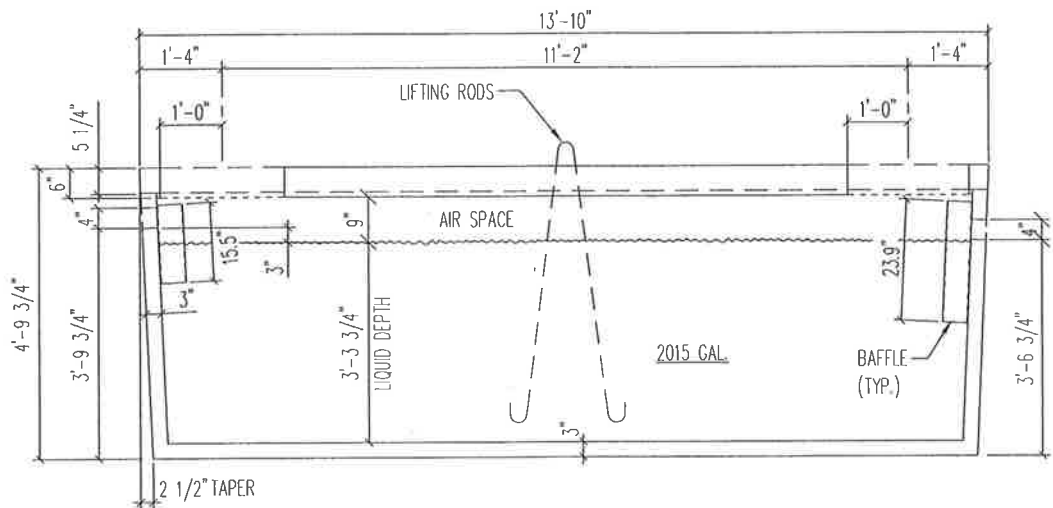

SECTION A-A
 $1/2" = 1'-0"$

- NOTE:**
1. PROVIDE MINIMUM 1" CLEAR BETWEEN TOP OF BAFFLE AND UNDERSIDE OF LID.
 2. PUMP TANK (PT) HAS NO OUTLET BAFFLE.

2000 GALLON SEPTIC OR PUMP TANK
 (2000 ST OR 2000 PT)



WEIGHT=16,800#
 MAX. SOIL COVER= 4'-0"